flawa iQ professional first aid

Commissioning eyewash station

Four chapters to a monitored eyewash station that is ready for use.

1 **Fit the magnetic switch**
Not needed if flawa iQ supplies the wall box.

2 **Mount the wall box**
Not needed if the box is already mounted.

3 **Position the control system**
Stick on the control system, insert the bottles.

4 **Signal test**
Check the connection and activate the station.

1 Fit the magnetic switch to the green wall box

Are you receiving the green wall box directly from flawa iQ? Then skip this chapter and continue with chapter 2.

1 Open the green box and remove the yellow protective film from the magnetic switch.


Magnetic switch with arrow

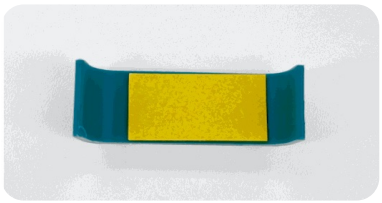
Magnetic switch with protective film, back

2 Stick the magnetic switch firmly to the inner projection of the lid. The magnet must be visible from above. The embossed arrow points towards the eyewash bottles.

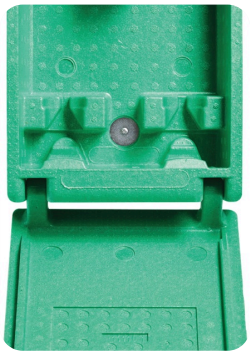
Projection on the lid

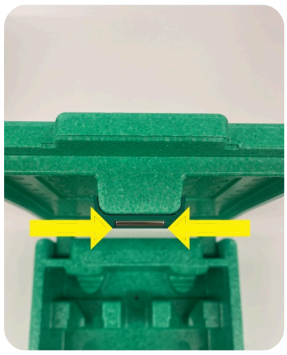
View from above

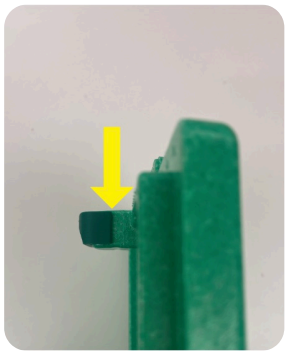
Side view, magnet flush at the top


Arrow points to the bottles

3 Press the magnetic switch firmly onto the projection. Fully open and close the box three to four times. Attach the supplied sticker at the bottom centre of the front.



Sticker on the front

2 Mount the green wall box

Is the wall box already mounted? Then skip this chapter and continue with chapter 3.

1 Check the location label. It is on the right-hand side of the green wall box.



Location sticker on the wall box

2 Mount the green wall box at the intended location. The screws are inside the box.

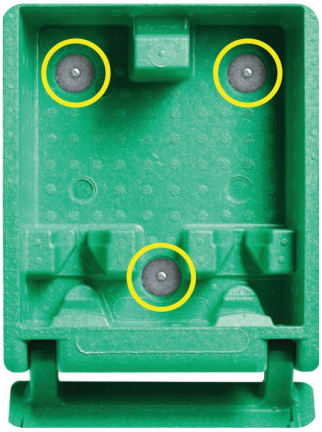
Fixing points

3 Position the control system

1. Clean the top surface of the wall box thoroughly. Check the location label on the right-hand side of the control system. Remove the red protective film from the adhesive on the underside of the control system.



Location label

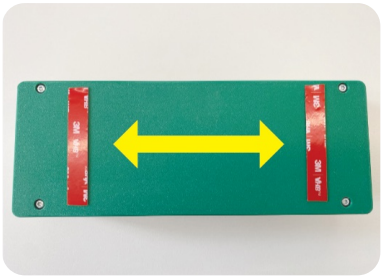
Red protective film of the adhesive

2. Place the control system on the green wall box flush at the left, front and back, and press it on firmly.

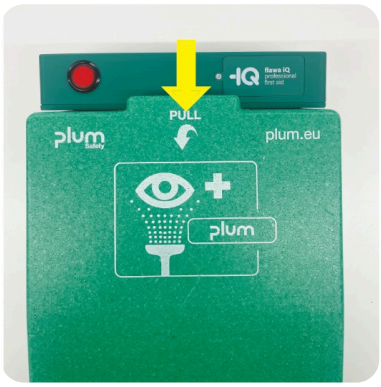

From the front: centred


From the side: flush at the back

3. Insert the supplied eyewash bottles.


RFID tag on the underside of the bottle

⚠ **Important:** The system only works with bottles from flawa iQ. They have a white RFID tag on the underside.

4 Signal test of the control system

Before the control system can be activated, the signal quality at the site is checked.

1 Press the button on the control system twice in quick succession. It then flashes steadily for 30 to 60 seconds.



Button on the control system

2 Watch the flashing pattern.

Button lights up for 10 seconds

Signal test successful. Continue with step 3.

Button flashes quickly

Transmission not successful. Contact support: **support@flawa-iq.ch**, +41 71 394 94 19.

3 Log in at **www.iq-portal.ch** with the user name and password you received. The start page shows all systems. Commissioning is successful as soon as the red bar 'Commissioning pending' disappears from the system (about 5 minutes after pressing the button).

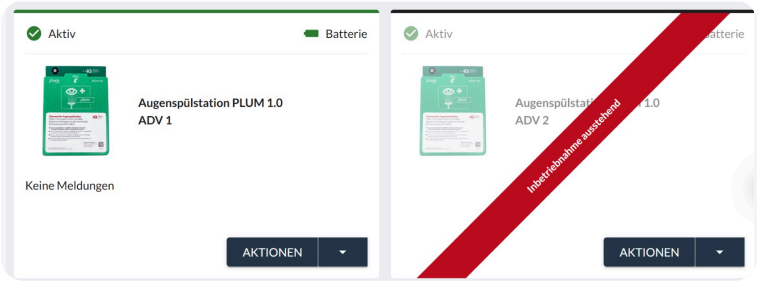

Left: active. Right: commissioning pending.

No bar visible

Signal test successful.

Red bar visible

Signal test not successful. Contact support: **support@flawa-iq.ch**, +41 71 394 94 19.

Your eyewash station is activated

- From now on, bottles that are removed are replaced automatically.
- If your system has the alarm function, activate it in the iQ Portal. You have received the link to the instructions by e-mail.